
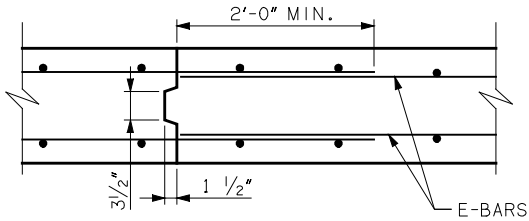


DESCRIPTION	REVISIONS	DATE
REVISED BI & ADDED A3		

[illegible]

TRANSV. CONSTR. JOINT

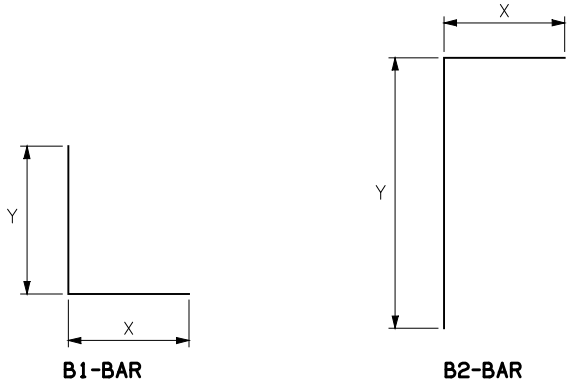

BAR BEND DIAGRAMS

NOTE: ALL "X" DIMENSIONS ARE HORIZONTAL IN BARREL SECTION.
ALL "Y" DIMENSIONS ARE VERTICAL IN BARREL SECTION.

SECTION DIMENSIONS		QUANTITIES	
		PER FOOT OF BARREL	
S	H	CONC. (C.Y.)	REINF. (LB.)
18'	9'	7.39	1515.3
18'	10'	7.55	1512.5
18'	11'	7.71	1540.8
18'	12'	7.87	1559.2
18'	15'	9.18	1712.0

DESIGN DATA:


1. DESIGNED IN ACCORDANCE WITH 1998 AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS AND INTERIM SPECIFICATIONS FROM 1999, 2000, 2001 AND 2002.
2. DESIGNED FOR HL-93 LOADING AND ODOT OVERLOAD TRUCK.
3. MATERIALS:
 CONCRETE (CLASS AA) $f'_c = 4$ KSI
 REINFORCING STEEL $f_y = 60$ KSI

GENERAL NOTES:

1. ALL CONSTRUCTION AND MATERIAL REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE 1999 OKLAHOMA STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION.
2. ALL CONCRETE EDGES SHALL HAVE A 1 1/2" CHAMFER UNLESS OTHERWISE SHOWN OR NOTED. ALL CHAMFER STRIPS SHALL BE SIZED LUMBER.
3. ALL REINFORCING STEEL SHALL HAVE A 2" MINIMUM CLEAR COVER UNLESS OTHERWISE SHOWN.
4. THE QUANTITY FOR REINFORCING STEEL DOES NOT INCLUDE LAP SPLICES OF E1-BARS OR E2-BARS IN THE LENGTH OF THE BARREL OR AT TRANSVERSE CONSTRUCTION JOINTS. THE SPLICE LENGTH FOR E-BARS SHALL BE 24" MINIMUM. THE NUMBER OF SPLICES USED IS TO BE APPROVED BY THE ENGINEER. REINFORCING STEEL FOR SPLICES SHALL NOT BE MEASURED FOR PAYMENT, AND ALL COSTS WILL BE INCLUDED IN THE UNIT BID PRICE FOR REINFORCING STEEL.
5. TRANSVERSE CONSTRUCTION JOINTS SHALL BE PLACED IN ALL CULVERTS 100 FT. OR MORE IN LENGTH. JOINTS SHALL BE SPACED AT 60 FT. MAX.
6. REINFORCING STEEL SHALL BE CONTINUOUS THROUGH THE TRANSVERSE CONSTRUCTION JOINT AND EXTEND A MIN. OF 24" INTO ADJACENT SECTION.

BASIS OF PAYMENT		
ITEM NO.	ITEM	UNIT
509.06 (A)	CLASS AA CONCRETE	C.Y.
511.06 (A)	REINFORCING STEEL	LB.

NOTE: NUMBER AND SPACING OF E-BARS
SHOWN MAY NOT BE REPRESENTATIVE
OF ACTUAL CULVERT SECTIONS, SEE
SCHEDULE ABOVE FOR NUMBER AND
SPACING OF E-BARS.

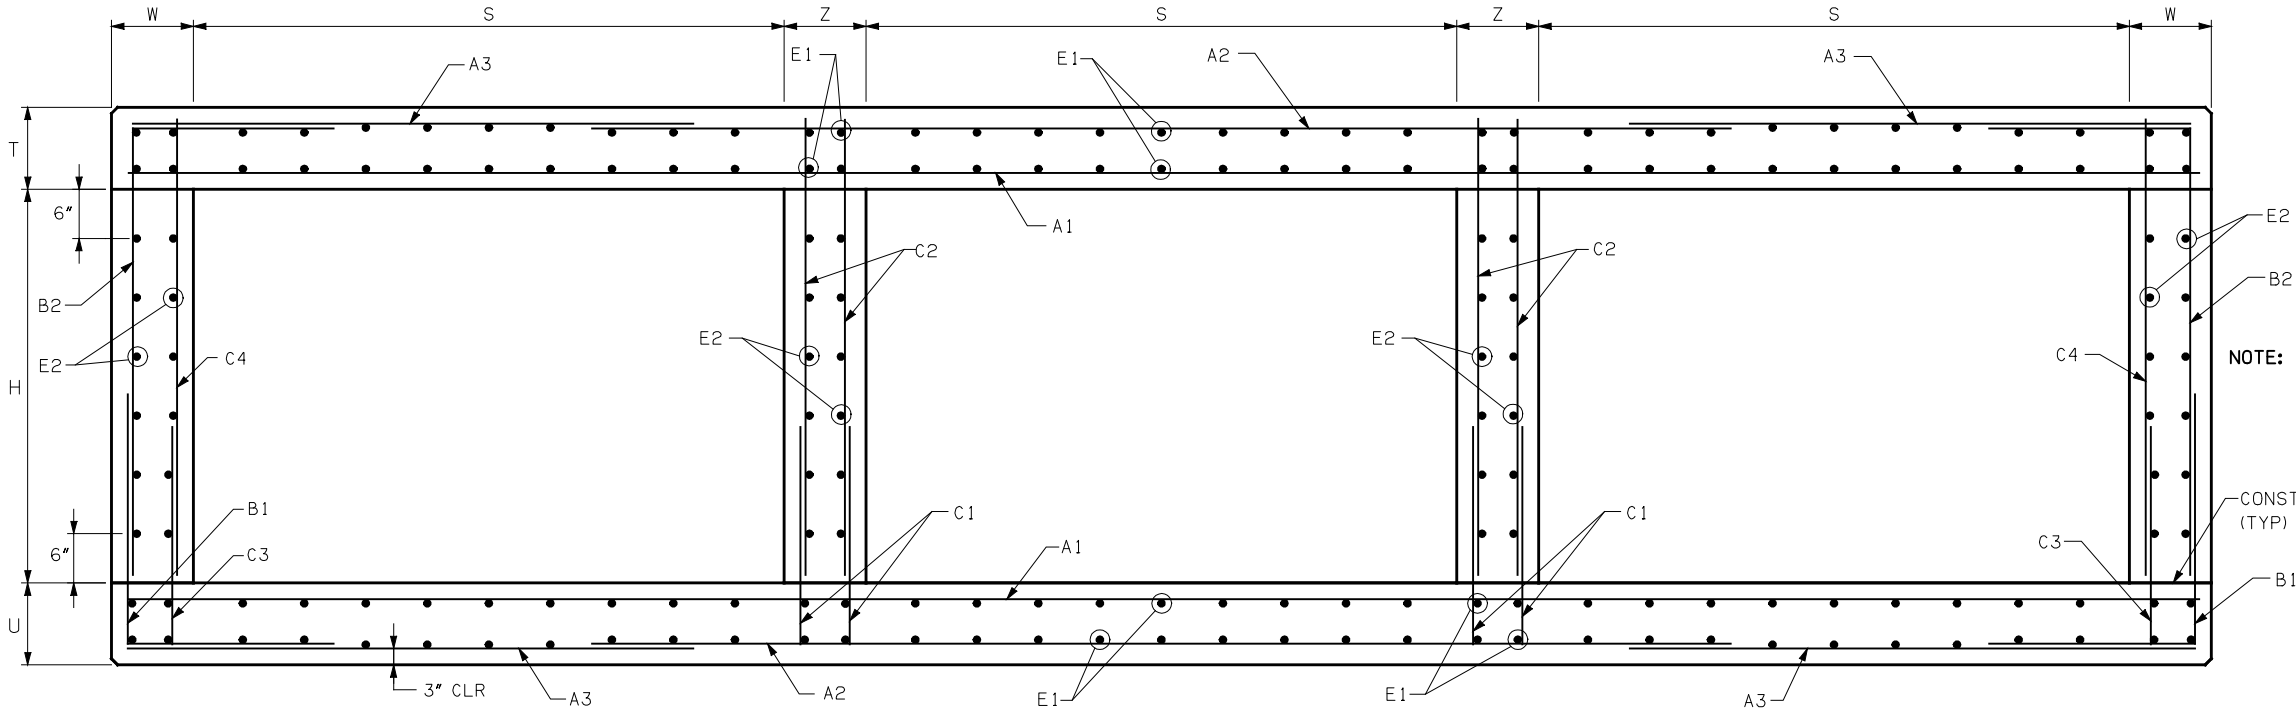-CONST. JT.
(TYP)

BARREL SECTION

APPROVED BY BRIDGE ENGINEER

DATE 3-13-08

OKLAHOMA DEPT. OF TRANSPORTATION
BRIDGE STANDARD (ENGLISH)
RCB CULVERTS - BARREL DETAILS
18'-0" SPAN - TRIPLE CELL
2 FT. TO 8 FT. FILL

1999 SPECIFICATIONS

RCB-C3-18(2-8)

01E

B-561