

PLAN VIEW - STANDARD CURB INLET


DESIGNATION	CURB INLET SCHEDULE		
	DESIGN 1	DESIGN 2	DESIGN 3
STD.	3'-7"	6'-2"	11'-6"
A	6'-3"	8'-10"	14'-2"
B	8'-11"	11'-6"	16'-10"
C	11'-7"	14'-2"	19'-6"
D	14'-4"	16'-11"	22'-3"
2A	8'-11"	11'-6"	16'-10"
A-B	11'-7"	14'-2"	19'-6"
A-C	14'-3"	16'-10"	22'-2"
2B	14'-3"	16'-10"	22'-2"
B-C	16'-11"	19'-6"	24'-10"
2C	19'-7"	22'-2"	27'-6"
B-D	19'-8"	22'-3"	27'-7"
2D	25'-1"	27'-8"	33'-0"

CURB INLET ADDITIONAL OPENINGS	
CURB OPENING DESIGNATION	THROAT SECTION LENGTH
A	2'-8"
B	5'-4"
C	8'-0"
D	10'-9"


① STANDARD DEPTH
 2'-9" FOR 18" DIA. PIPE
 3'-4" FOR 24" DIA. PIPE
 4'-0" FOR 30" DIA. PIPE
 4'-6" FOR 36" DIA. PIPE

DESIGN DATA
MATERIAL:
 CLASS A CONCRETE $f_c = 4$ KSI
 REINFORCING STEEL $f_y = 60$ KSI
LOADING:
 HL-93
DESIGN:
 AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, 7TH EDITION
 ASTM C890
 ASTM C913

- GENERAL NOTES**
- ALL CONSTRUCTION AND MATERIAL REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE 2019 ODOT STANDARD SPECIFICATIONS.
 - FOR DETAILS OF FRAMES, GRATES AND HOODS SEE ROADWAY STANDARDS SSIF-5, CIG-4 AND CI-2. COST OF FRAMES, GRATES AND HOODS SHALL BE INCLUDED IN THE COST OF THE STRUCTURE.
 - THERE SHALL BE A MINIMUM VERTICAL DISTANCE OF 6" BETWEEN AN OPENING AND ANY EDGE.
 - PROVIDE LIFTING DEVICES IN CONFORMANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
 - PROVIDE GRADE 60 REINFORCING STEEL CONFORMING TO ASTM A615 OR EQUIVALENT AREA OF WELDED WIRE REINFORCING CONFORMING TO ASTM A1064.
 - PROVIDE A MINIMUM CLEAR COVER OF 1 1/2" TO REINFORCING STEEL.
 - WALLS OR SLABS WITH A THICKNESS OF 8" OR GREATER REQUIRE A SECONDARY LAYER OF REINFORCING STEEL. PROVIDE AN AREA OF REINFORCING STEEL EQUAL TO 0.11 IN²/FT EACH WAY IN THE SECONDARY LAYER.
 - BLOCKOUTS IN WALLS MAY BE FORMED FOR GRATE SUPPORT BEAMS. THE SUPPORT BEAM SHALL BE OF SIZE S4x7.7 OR AS DESCRIBED ON ROADWAY STANDARD SSIF-5.
 - MAXIMUM OPENING DIAMETER SHALL BE 4" LARGER THAN OUTSIDE DIAMETER OF PIPE.
 - DO NOT GROUT RUBBER GASKET JOINTS WITHOUT THE MANUFACTURER'S RECOMMENDATIONS.
 - THE FOUNDATION SHALL BE STABILIZED OR REMOVED AND REPLACED WITH FIRM AND STABLE FOUNDATION MATERIAL. A MINIMUM 3" THICK LEVELING COURSE SHALL BE PROVIDED BELOW THE BASE AREA OF THE INLET AND EXTEND 6" BEYOND THE BASE AREA. THE LEVELING COURSE SHALL BE CONSTRUCTED WITH AGGREGATE BASE TYPE A. COSTS ASSOCIATED WITH THE FOUNDATION AND LEVELING COURSE SHALL BE INCLUDED IN THE PRICE BID OF THE STRUCTURE.
 - WALLS AND SLABS WILL HAVE A MINIMUM THICKNESS OF 6". A TOLERANCE OF ±3/8" WILL BE ALLOWED FOR FABRICATION.
 - FLEXURAL REINFORCING STEEL SHALL NOT EXCEED SPACING OF 6" CENTER TO CENTER

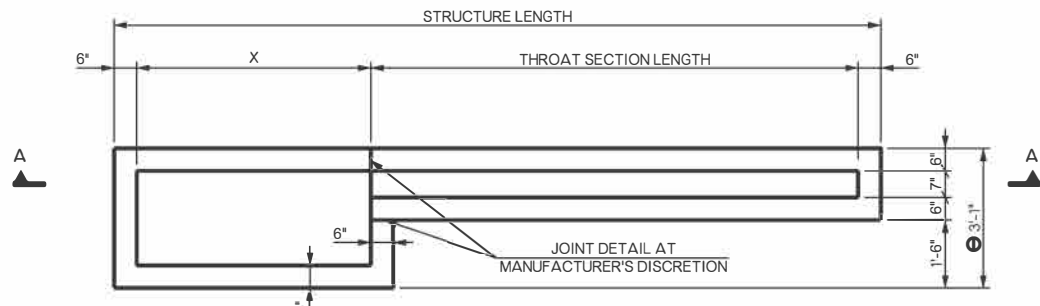


PLAN VIEW - CURB INLET WITH ADDITIONAL OPENINGS
 NOTE: THROAT SECTION MAY ENTER EITHER OR BOTH SIDES OF CURB INLET.

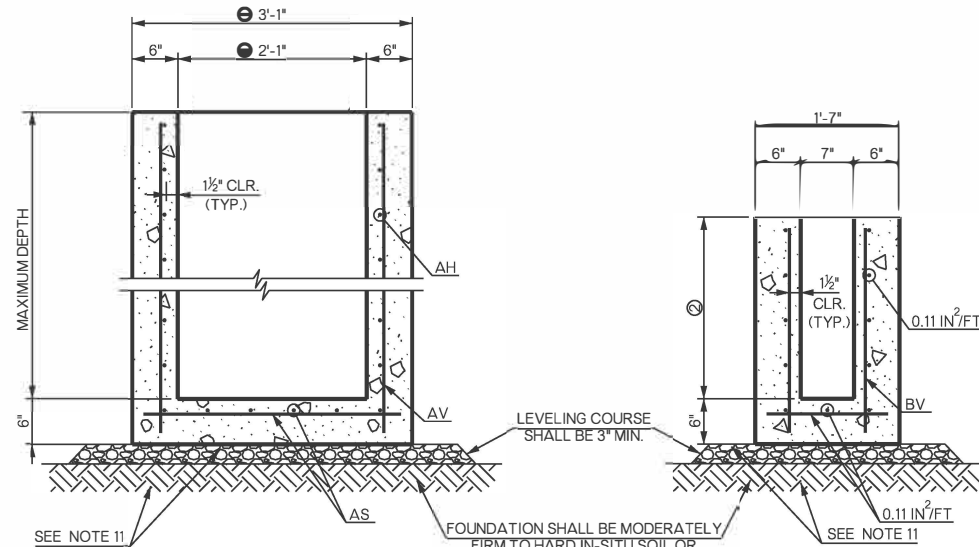


CROSS-SECTIONAL VIEW - CURB INLET

CROSS-SECTIONAL VIEW - THROAT

② STANDARD DEPTH SHALL BE AS SHOWN IN STANDARD DEPTH TABLE ABOVE. NON-STD. DEPTH SHALL BE A MINIMUM OF 2'-0" AND A MAXIMUM OF 5'-0"

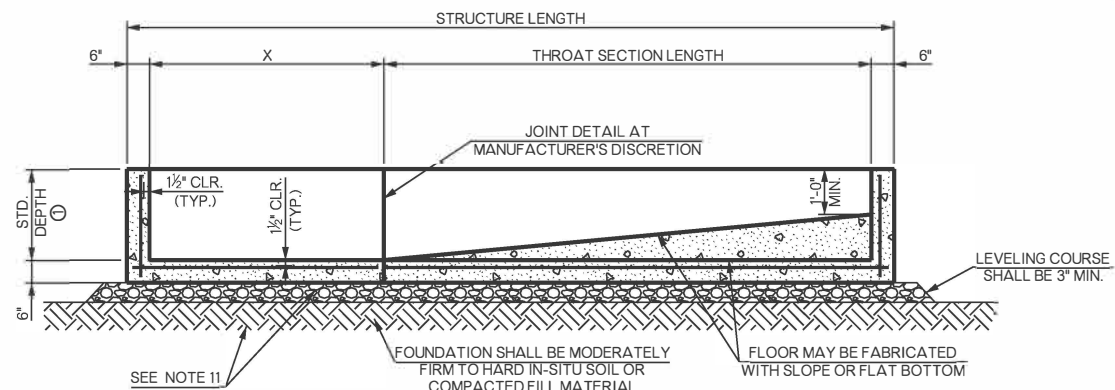

SECTION A-A - STANDARD DEPTH

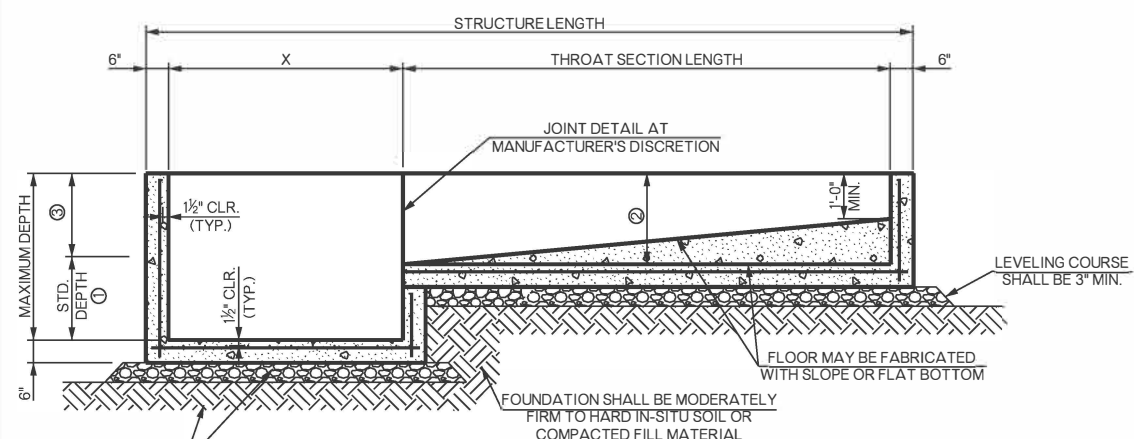

SECTION A-A - NON-STANDARD DEPTH
 ③ ADDITIONAL CURB INLET DEPTH PER VERTICAL FOOT

INLET DESIGN	EX	EY	SCHEDULE OF DIMENSIONS AND REINFORCING STEEL												
			AH BARS (IN ² /FT)								AS BARS (IN ² /FT)	AV BARS (IN ² /FT)	BV BARS (IN ² /FT)		
			DEPTH										DEPTH		
3'	4'	5'	6'	7'	8'	9'	10'	3'	4'	5'					
1	2'-7"	3'-7"	0.11	0.11	0.11	0.11	0.11	0.11	0.11	0.20	0.11				
2	5'-2"	6'-2"	0.11	0.11	0.11	0.11	0.11	0.12	0.13	0.14	0.18	0.11	0.11	0.16	0.26
3	10'-6"	11'-6"	0.20	0.25	0.29	0.33	0.37	0.41	0.46	0.50	0.13	0.17			

④ DIMENSIONS SHOWN ARE THE MAXIMUM DIMENSIONS ALLOWED. INLET DIMENSIONS LESS THAN THOSE SHOWN ARE ACCEPTABLE FOR THE APPLICABLE INLET DESIGN NUMBER PROVIDED THE DIMENSIONS MEET GEOMETRIC REQUIREMENTS OF THE FRAMES, GRATES AND HOODS.

REINFORCING STEEL VALUES LISTED IN "SCHEDULE OF DIMENSIONS AND REINFORCING STEEL" ARE MINIMUM VALUES. STRUCTURES THAT PROVIDE VALUES LARGER THAN THOSE SHOWN WILL BE CONSIDERED ACCEPTABLE.

BASIS OF PAYMENT		
ITEM NO.	ITEM	UNIT
611(G)	PRECAST INLET CI DES. 1 (STD)	EA.
611(G)	PRECAST INLET CI DES. 1 (A)	EA.
611(G)	PRECAST INLET CI DES. 1 (B)	EA.
611(G)	PRECAST INLET CI DES. 1 (C)	EA.
611(G)	PRECAST INLET CI DES. 1 (D)	EA.
611(G)	PRECAST INLET CI DES. 1 (2A)	EA.
611(G)	PRECAST INLET CI DES. 1 (A-B)	EA.
611(G)	PRECAST INLET CI DES. 1 (A-C)	EA.
611(G)	PRECAST INLET CI DES. 1 (2B)	EA.
611(G)	PRECAST INLET CI DES. 1 (B-C)	EA.
611(G)	PRECAST INLET CI DES. 1 (2C)	EA.
611(G)	PRECAST INLET CI DES. 2 (STD)	EA.
611(G)	PRECAST INLET CI DES. 2 (B)	EA.
611(G)	PRECAST INLET CI DES. 2 (C)	EA.
611(G)	PRECAST INLET CI DES. 2 (D)	EA.
611(G)	PRECAST INLET CI DES. 2 (2B)	EA.
611(G)	PRECAST INLET CI DES. 2 (2C)	EA.
611(G)	PRECAST INLET CI DES. 2 (B-D)	EA.
611(G)	PRECAST INLET CI DES. 2 (2D)	EA.
611(G)	PRECAST INLET CI DES. 3 (STD)	EA.
611(G)	PRECAST INLET CI DES. 3 (B)	EA.
611(G)	PRECAST INLET CI DES. 3 (D)	EA.
611(G)	PRECAST INLET CI DES. 3 (2B)	EA.
611(G)	PRECAST INLET CI DES. 3 (B-D)	EA.
611(G)	PRECAST INLET CI DES. 3 (2D)	EA.
611(G)	ADD'L DEPTH IN PRECAST INLET CI DES. 1	VF
611(G)	ADD'L DEPTH IN PRECAST INLET CI DES. 2	VF
611(G)	ADD'L DEPTH IN PRECAST INLET CI DES. 3	VF

APPROVED BY ROADWAY ENGINEER: *[Signature]* DATE: 6/30/22
 ROADWAY DESIGN DIVISION STANDARD

OKLAHOMA Transportation PRECAST CURB INLET (DESIGNS 1, 2 AND 3)
 2019 SPECIFICATIONS