


DESIGN DATA

MATERIAL:
CLASS A CONCRETE
REINFORCING STEEL

$f'_c = 4 \text{ KSI}$
 $f_y = 60 \text{ KSI}$


LOADING:
HL-93

DESIGN:
AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, LATEST EDITION
ASTM C478
ASTM C890
ASTM C913

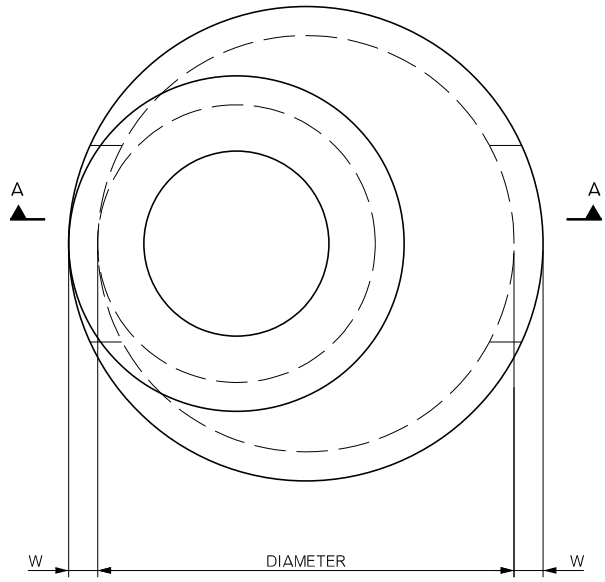


PLAN VIEW - ROUND REDUCED RISER

ROUND MANHOLE, TYPE I

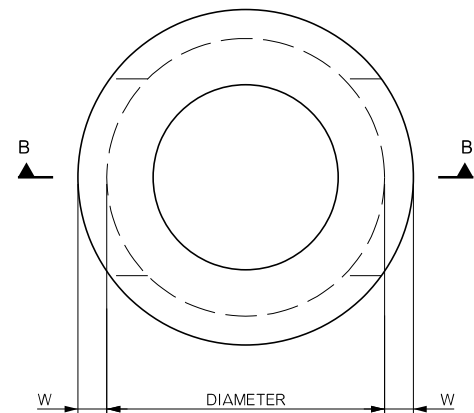

PLAN VIEW - ROUND RISER

ROUND MANHOLE, TYPE II

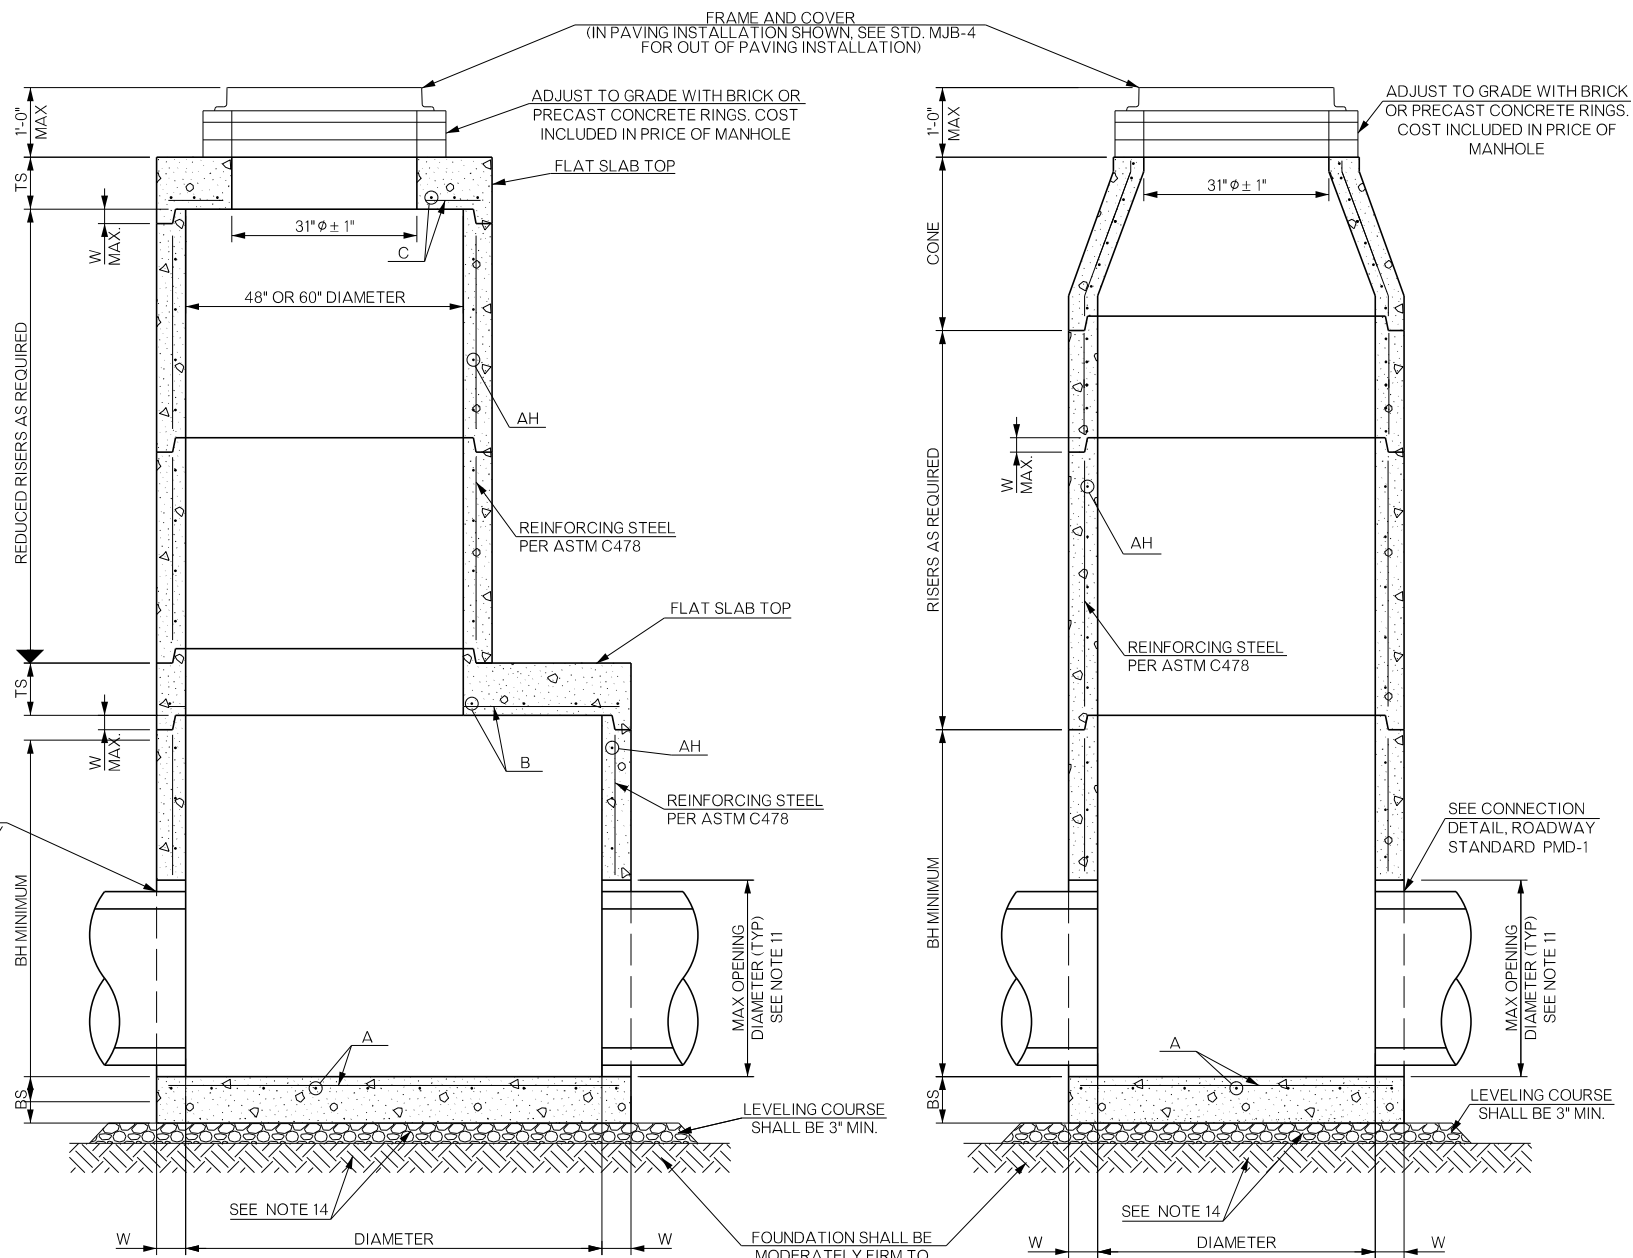

TYPE I SECTION A-A
ROUND REDUCED RISER OPTION
SHOWING FLAT SLAB TOP.
CONE MAY BE USED.

TYPE II SECTION B-B
ROUND RISER OPTION
SHOWING CONE.
FLAT SLAB TOP MAY BE USED.

SCHEDULE OF DIMENSIONS AND REINFORCING STEEL

DIAMETER	DEPTH ≤ 25 FT.							
	BH	BS	TS	W	A	B	C	AH
48"	12"	6"	6"	5"	0.27 IN ² /FT	-	0.28 IN ² /FT	0.12 IN ² /FT
60"	36"	8"	8"	6"	0.27 IN ² /FT	0.41 IN ² /FT	0.30 IN ² /FT	0.15 IN ² /FT
72"	36"	8"	8"	7"	0.35 IN ² /FT	0.48 IN ² /FT	0.41 IN ² /FT	0.18 IN ² /FT

TO INCLUDE A REDUCED RISER, DEPTH OF MANHOLE MUST BE A MINIMUM OF 52 INCHES.

VALUES LISTED IN "SCHEDULE OF DIMENSIONS AND REINFORCING STEEL" ARE MINIMUM VALUES. STRUCTURES THAT PROVIDE LARGER VALUES THAN THOSE SHOWN WILL BE CONSIDERED ACCEPTABLE.

DEPTH OF UP TO, AND INCLUDING, 6' SHALL BE INCLUDED IN PRICE BID PER MANHOLE. ANY DEPTH ABOVE 6' TO A MAXIMUM DEPTH OF 25', SHALL BE PAID FOR AS 'ADDITIONAL DEPTH.'

THE DETAILS SHOWN ON THIS SHEET ARE FOR STORM SEWER APPLICATIONS ONLY AND ARE NOT INTENDED FOR SANITARY SEWER APPLICATIONS.

GENERAL NOTES

- ALL CONSTRUCTION AND MATERIAL REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE 2019 ODOT STANDARD SPECIFICATIONS.
- FOR DETAILS OF FRAME AND COVER, SEE THE CURRENT VERSION OF ROADWAY STANDARD MFC-5. PRICE BID OF MANHOLE SHALL INCLUDE PAYMENT FOR THESE ITEMS AND ALL OTHER ITEMS AND LABOR NECESSARY TO COMPLETE THE INSTALLATION. PRICE BID OF ADDITIONAL DEPTH SHALL INCLUDE PAYMENT FOR ALL MATERIAL AND LABOR, PERTAINING ONLY TO THE ADDITIONAL DEPTH, NECESSARY TO COMPLETE ITS INSTALLATION.
- SQUARE MANHOLES MAY BE SUBSTITUTED PER THE MANUFACTURER'S RECOMMENDATION. SEE THE CURRENT VERSION OF ROADWAY STANDARD PSM-1 FOR MATERIAL AND INSTALLATION DETAILS.
- PIPE OPENINGS SHALL NOT BE LOCATED IN A CONE SECTION.
- THERE SHALL BE A MINIMUM DISTANCE OF 6 INCHES BETWEEN AN OPENING AND ANY JOINT.
- PROVIDE LIFTING DEVICES IN CONFORMANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE GRADE 60 REINFORCING STEEL CONFORMING TO ASTM A615 OR EQUIVALENT AREA OF WELDED WIRE REINFORCING CONFORMING TO ASTM A1064. PROVIDE CIRCUMFERENTIAL REINFORCING STEEL IN VERTICAL WALLS OF BASE, RISER, AND CONE IN ACCORDANCE WITH ASTM C478.
- PROVIDE A MINIMUM CLEAR COVER OF 1 1/2 INCHES TO REINFORCING STEEL.
- WALLS OR SLABS WITH A THICKNESS OF 8 INCHES OR GREATER REQUIRE A SECONDARY LAYER OF REINFORCING STEEL. PROVIDE AN AREA OF REINFORCING STEEL EQUAL TO 0.11 SQ. IN./FT EACH WAY IN THE SECONDARY LAYER.
- DESIGN TONGUE AND GROOVE JOINTS FOR FULL CLOSURE ON RISER SHOULDERS, CONICAL TOPS, AND FLAT SLABS. MINIMUM SPIGOT DEPTH IS 3/4 INCHES.
- MAXIMUM OPENING SHALL BE 4 INCHES LARGER THAN OUTSIDE PIPE DIAMETER. REFER TO THE MOST CURRENT VERSION OF ROADWAY DESIGN STANDARD PMD-1 FOR PIPE CONNECTION MATERIAL.
- SEAL TONGUE AND GROOVE JOINTS WITH PREFORMED OR BULK MASTIC IN CONFORMANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. TONGUE AND GROOVE JOINTS MAY BE GROUTED NO MORE THAN 1 INCH BETWEEN EACH SECTIONS OR 1/2 THE JOINT DEPTH, WHICHEVER IS GREATER. JOINT SEALING SHALL BE INCLUDED IN THE COST OF THE MANHOLE.
- DO NOT GROUT RUBBER GASKET JOINTS WITHOUT THE MANUFACTURER'S RECOMMENDATIONS.
- THE FOUNDATION SHALL BE STABILIZED OR REMOVED AND REPLACED WITH FIRM AND STABLE FOUNDATION MATERIAL. A MINIMUM 3 INCHES THICK LEVELING COURSE SHALL BE PROVIDED BELOW THE BASE AREA OF THE MANHOLE AND EXTEND 6 INCHES BEYOND THE BASE AREA. THE LEVELING COURSE SHALL BE CONSTRUCTED WITH AGGREGATE BASE TYPE A. COSTS ASSOCIATED WITH THE FOUNDATION AND LEVELING COURSES SHALL BE INCLUDED IN THE PRICE BID OF THE MANHOLE.
- OPENINGS IN FLAT SLAB TOPS SHALL BE ADDITIONALLY REINFORCED WITH A MINIMUM OF 0.20 SQ. IN. OF REINFORCING STEEL AT 90 DEGREES.
- REFER TO PROJECT PLAN SHEETS FOR NUMBER, LOCATION, AND SIZE OF PIPE.
- FLEXURAL REINFORCING STEEL SHALL NOT EXCEED SPACING OF 9 INCHES CENTER TO CENTER.
- PRECAST CONCRETE GRADE RING WALL THICKNESS SHALL BE 1/2 OF INTERNAL DIAMETER OR 4 INCHES, WHICHEVER IS GREATER.
- THE ENGINEER MAY SPECIFY THE USE OF STEPS OR LADDERS AND SHALL CONFORM TO ASTM C478.
- THE ORIENTATION OF THE SPIGOT IS SHOWN FOR INFORMATIONAL PURPOSES ONLY AND IS AT THE DISCRETION OF THE MANUFACTURER.

BASIS OF PAYMENT		
ITEM NO.	ITEM	UNIT
611(A)	PRECAST CONC RND 4' DIA MANHOLE	EACH
611(A)	PRECAST CONC RND 5' DIA MANHOLE	EACH
611(A)	PRECAST CONC RND 6' DIA MANHOLE	EACH
611(B)	ADD'L DEPTH PRECAST RND 4' MANHOLE	VF
611(B)	ADD'L DEPTH PRECAST RND 5' MANHOLE	VF
611(B)	ADD'L DEPTH PRECAST RND 6' MANHOLE	VF

APPROVED BY ROADWAY ENGINEER: *[Signature]* DATE: 1/8/2025
ROADWAY DESIGN DIVISION STANDARD



PRECAST ROUND MANHOLE

2019 SPECIFICATIONS

PRM-1	3
	R-50