DESIGN DATA

MATERIAL: CLASS A CONCRETE REINFORCING STEEL


f'c = 4 KSIfy = 60 KSI

LOADING: HL-93

DESIGN: AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, LATEST EDITION ASTM C913

4'-0" OR 5'-0" MANHOLE WIDTH

☑ PLAN VIEW - SQUARE REDUCED RISER SQUARE MANHOLE, TYPE I

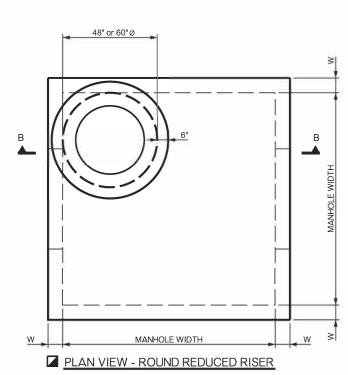

SQUARE MANHOLE, TYPE II

TO INCLUDE A REDUCED RISER, DEPTH OF MANHOLE MUST BE A MINIMUM OF 52 INCHES.

DEPTH OF UP TO, AND INCLUDING, 6' SHALL BE INCLUDED IN PRICE BID PER MANHOLE. ANY DEPTH ABOVE 6' SHALL BE PAID FOR AS 'ADDITIONAL DEPTH.'

FRAME AND COVER
(IN PAVING INSTALLATION SHOWN, SEE STD. MJB-4
FOR OUT OF PAVING INSTALLATION) ADJUST TO GRADE WITH BRICK OR ADJUST TO GRADE WITH BRICK OR PRECAST CONCRETE RINGS. COST PRECAST CONCRETE RINGS. COST INCLUDED IN PRICE OF MANHOLE. INCLUDED IN PRICE OF MANHOLE. FLAT SLAB TOP FLAT SLAB TOP 31"ر1" 31"ر 1" 48" OR 60" DIAMETER 4'-0" OR 5'-0' SEE STANDARD PRM-1 PER ASTM C478 FLAT SLAB TOP FLAT SLAB TOP FOUNDATION SHALL BE MODERATELY FIRM TO SEE NOTE 13 SEE NOTE 13 HARD IN-SITU MATERIAL OR COMPACTED MATERIAL. MANHOLE WIDTH MANHOLE WIDTH TYPE I TYPE II

SECTION A-A SQUARE REDUCED RISER OPTION SHOWING FLAT SLAB TOP.

SECTION B-B ROUND REDUCED RISER OPTION SHOWING FLAT SLAB TOP. CONE MAY BE USED.

SCHEDULE OF DIMENSIONS AND REINFORCING STEEL											
MANHOLE	DEPTH ≤ 25 FT.										
WIDTH	ВН	BS	TS	W	Α	В	С	АН	AV		
48"	12"	6"	6"	6"	0.49 IN ² /FT	FĪS	0.28 IN ² /FT	0.24 IN ² /FT	0.11 IN ² /FT		
60"	36"	6"	8"	6"	0.63 IN ² /FT	0.41 IN ² /FT	0.30 IN ² /FT	0.36 IN ² /FT	0.11 IN ² /FT		
72"	36"	6"	8"	8"	0.61 IN ² /FT	0.48 IN ² /FT	0.41 IN ² /FT	0.34 IN ² /FT	0.11 IN ² /FT		

VALUES LISTED IN "SCHEDULE OF DIMENSIONS AND REINFORCING STEEL" ARE MINIMUM VALUES. STRUCTURES THAT PROVIDE LARGER VALUES THAN THOSE SHOWN WILL BE CONSIDERED ACCEPTABLE.

THE DETAILS SHOWN ON THIS SHEET ARE FOR STORM SEWER APPLICATIONS ONLY AND ARE NOT INTENDED FOR SANITARY SEWER APPLICATIONS.

GENERAL NOTES

- 1. ALL CONSTRUCTION AND MATERIAL REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE 2019 ODOT STANDARD SPECIFICATIONS.
 - FOR DETAILS OF FRAME AND COVER, SEE CURRENT VERSION OF ROADWAY STANDARD MFC-5. PRICE BID OF MANHOLE SHALL INCLUDE PAYMENT FOR THESE ITEMS AND ALL OTHER ITEMS AND LABOR, NECESSARY TO COMPLETE THE INSTALLATION. PRICE BID OF ADDITIONAL DEPTH SHALL INCLUDE PAYMENT FOR ALL MATERIAL AND LABOR PERTAINING ONLY TO THE ADDITIONAL DEPTH, NECESSARY TO COMPLETE ITS INSTALLATION.
- 3. PRECAST ROUND MANHOLES MAY BE SUBSTITUTED PER THE MANU-FACTURER'S RECOMMENDATION. SEE ROADWAY STANDARD PRM-1 FOR DESIGN AND INSTALLATION DETAILS.
- 4. THERE SHALL BE A MINIMUM DISTANCE OF 6" BETWEEN AN OPENING AND ANY JOINT.
- 5. PROVIDE LIFTING DEVICES IN CONFORMANCE WITH THE MANUFACTURER'S RECOMMENDATIONS
- PROVIDE GRADE 60 REINFORCING STEEL CONFORMING TO ASTM A615 OR EQUIVALENT AREA OF WELDED WIRE REINFORCING CONFORMING
- 7. PROVIDE A MINIMUM CLEAR COVER OF 11/2" TO REINFORCING STEEL.
- 8. WALLS OR SLABS WITH A THICKNESS OF 8" OR GREATER REQUIRE A WALLS ON SEAS WITH THICKNESS OF 8 OF SELATER REQUIRE A SECONDARY LAYER OF REINFORCING STEEL. PROVIDE AN AREA OF REINFORCING STEEL EQUAL TO 0.11 SQ. IN. / FT EACH WAY IN THE SECONDARY LAYER
- DESIGN TONGUE AND GROOVE JOINTS FOR FULL CLOSURE ON RISER SHOULDERS, CONICAL TOPS, AND FLAT SLABS. MINIMUM SPIGOT DEPTH
- 10. MAXIMUM OPENING SHALL BE 4" LARGER THAN OUTSIDE PIPE DIAMETER. REFER TO ROADWAY DESIGN STANDARD PMD-1 FOR PIPE CONNECTION
- SEAL TONGUE AND GROOVE JOINTS WITH PREFORMED OR BULK MASTIC IN CONFORMANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. TONGUE AND GROOVE JOINTS MAY BE GROUTED NO MORE THAN 1" BETWEEN EACH SECTIONS OR 1/2 THE JOINT DEPTH, WHICHEVER IS GREATER. JOINT SEALING SHALL BE INCLUDED IN THE COST OF THE
- 12. DO NOT GROUT RUBBER GASKET JOINTS WITHOUT THE MANUFACTURER'S RECOMMENDATIONS.
- THE FOUNDATION SHALL BE STABILIZED OR REMOVED AND REPLACED WITH FIRM AND STABLE FOUNDATION MATERIAL. A MINIMUM 3" THICK LEVELING COURSE SHALL BE PROVIDED BELOW THE BASE AREA OF THE MANHOLE AND EXTEND 6" BEYOND THE BASE AREA. THE LEVELING COURSE SHALL BE CONSTRUCTED WITH AGGREGATE BASE TYPE A. COSTS ASSOCIATED WITH THE FOUNDATION AND LEVELING COURSES SHALL BE INCLUDED IN THE PRICE BID OF THE MANHOLE.
- 14. OPENINGS IN FLAT SLAB TOPS SHALL BE ADDITIONALLY REINFORCED WITH A MINIMUM OF 0.20 SQ. IN. OF STEEL AT 90 DEGREES.
- 15. REFER TO PROJECT PLAN SHEETS FOR NUMBER, LOCATION, AND SIZE OF
- 16. FLEXURAL REINFORCING STEEL SHALL NOT EXCEED SPACING OF 9" CENTER TO CENTER.
- 17. SEE CURRENT VERSION OF ROADWAY STANDARD PRM-1 FOR DIMENSIONS AND REINFORCING REQUIREMENTS FOR PRECAST CONCRETE ROUND MANHOLES, WITH AND WITHOUT ROUND REDUCED RISER SECTIONS.
- 18. THE ENGINEER MAY SPECIFY THE USE OF STEPS OR LADDERS AND SHALL CONFORM TO ASTM C478.
- 19. THE ORIENTATION OF THE SPIGOT IS SHOWN FOR INFORMATIONAL PURPOSES ONLY AND IS AT THE DISCRETION OF THE MANUFACTURER.

-								
	BASIS OF PAYMENT							
	ITEM NO.	ITEM	UNIT					
1	611(A)	(SP) PRECAST CONC SQ 4' WIDE MANHOLE	EACH					
1	611(A)	(SP) PRECAST CONC SQ 5' WIDE MANHOLE	EACH					
1	611(A)	(SP) PRECAST CONC SQ 6' WIDE MANHOLE	EACH					
1	611(B)	(SP) ADD'L DEPTH PRECAST SQ 4' MANHOLE	VF					
1	611(B)	(SP) ADD'L DEPTH PRECAST SQ 5' MANHOLE	VF					
	611(B)	(SP) ADD'L DEPTH PRECAST SQ 6' MANHOLE	VF					

APPROVED BY ROADWAY ENGINEER

.DATE:_6/30/22

ROADWAY DESIGN DIVISION STANDARD

PRECAST SQUARE MANHOLE



PSM-1