


REVISIONS		
REV. NO.	DESCRIPTION	DATE
Various		09/05/2018

General Notes:


- LED luminaire fixture option, per IES TM-15-07 (revised) standards. See Standard HLD1-2 AND HLD2-2 (Latest Revision) for more details.
- HPS luminaire fixture option. See Standard HLD1-2 AND HLD2-2 (Latest Revision) for more details.
- Handholes on centerline poles shall be mounted on the same side as pole number. All pole numbers and handholes shall face the same direction.
- Dimensional limits are given to show acceptable variation in design. All of a fabricator's production of a particular arm length shall have the same dimensions within specified tolerances.
- Each pole arm plate shall be supplied with bolts and lock washers of the size specified. The bolts and lock washers shall be secured to the pole with the other hardware items called for in the plans.
- Proposed deviations in arm connector dimensions or materials must be submitted to the Department for approval.
- The handhole reinforcement shall be welded to the pole shaft in the 0 deg. location unless otherwise specified, prior to galvanizing the pole shaft.
- When aerial conductors are required, the pole shall be designed to meet the loading requirements of the National Electric Safety Code (NESC Latest Edition) for the aerial cable specified. Submit design and calculations for approval confirming the standard pole design is adequate for aerial cable installation or submit design and calculations for an optional pole design for approval.
- All poles with aerial conductors shall be equipped with a handhole and should not be installed on a breakaway base.
- If aerial conductors are specified, construct the items as shown.
- Hole shall be at least 2" diameter. Deburr edges inside and out.
- Weld shall be at least 0.13" x 0.25" unequal legs. Weld may be larger to accommodate fit up.
- Holes drilled into pole and Davit arm assembly to ensure secure fit of slip connection may be factory or field drilled. When field drilling, repair damage to galvanization by use of zinc-based solders or zinc-rich paint.

Material Specifications


- The handhole reinforcement shall be forged from steel conforming to ASTM A-576, Grade 1021: fabricated from 1/4" wall tubing conforming to ASTM A-36; or cast from steel conforming to ASTM A-27, Grade 65-35. The handhole cover shall be 12 gauge H.R.M.S. galvanized according to ASTM A-153, and equipped with two (2) AISI 302 stainless steel 1/4" - 20 x 3/4" hex cap screws and two (2) captive washers. Handhole cover to have neoprene gasket.
- Any of the materials listed for plates may be used where the drawings do not specify a particular ASTM designation.
- A576 must be suitable for forging and also meet minimum tensile strength of 65 ksi, minimum yield of 35 ksi, and elongation in 2 inches of 22 percent.
- A572, A1008 HSLAS-F, and A1011 HSLAS-F, materials may have higher yield strengths but shall not have less elongation than the grade indicated.

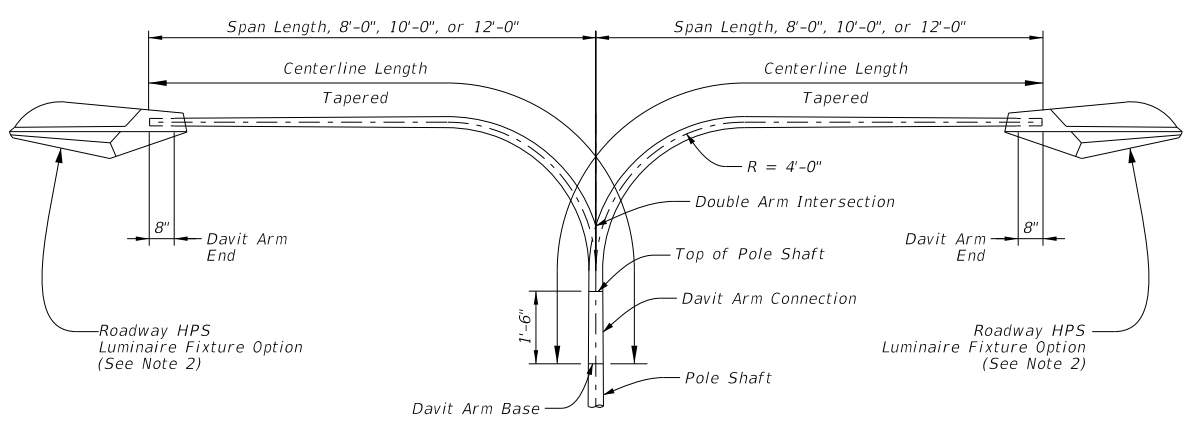


Double Davit Arm

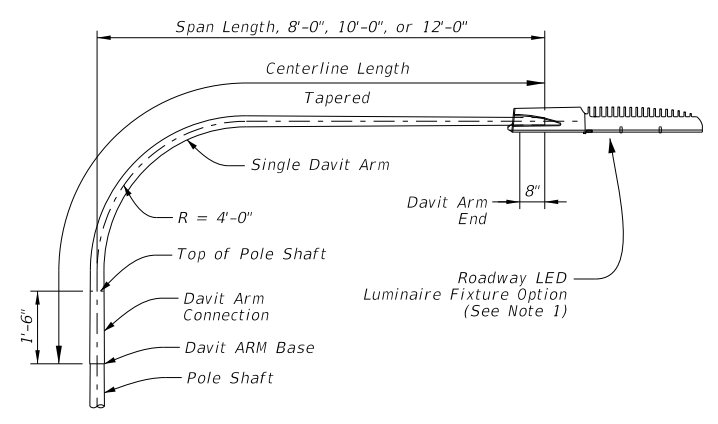



Single Davit Arm Detail

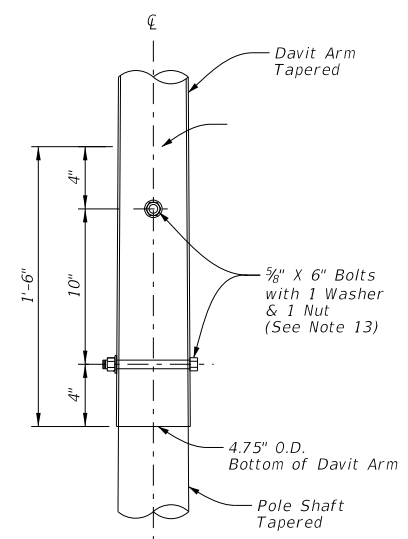

Davit Arm Connection

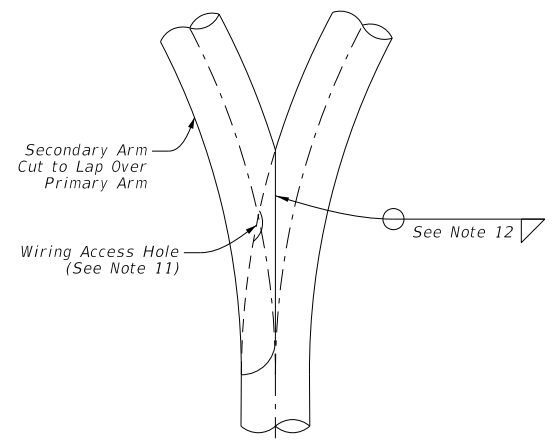


Double Arm Intersection

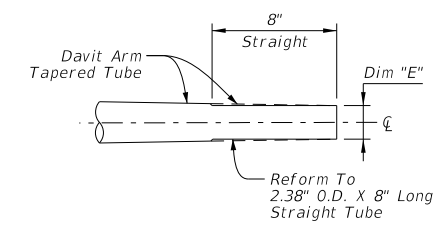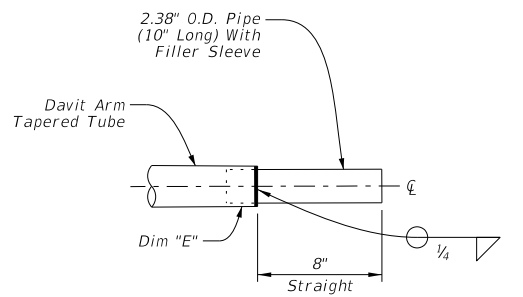

Mounting Height (FT)	Span Length (FT)	Centerline Length (FT)	Rise Height (FT)	Thickness (IN)	Base O.D. (IN)	Taper Rate (IN)	Dim "E" (IN)
20 - 40	8	12.78	6.5	0.1196	4.75	0.14	2.96
20 - 40	10	14.78	6.5	0.1196	4.75	0.14	2.68
30 - 40	12	16.78	6.5	0.1196	4.75	0.14	2.40

Davit Arm End Details
Davit Arm Dimensions Table

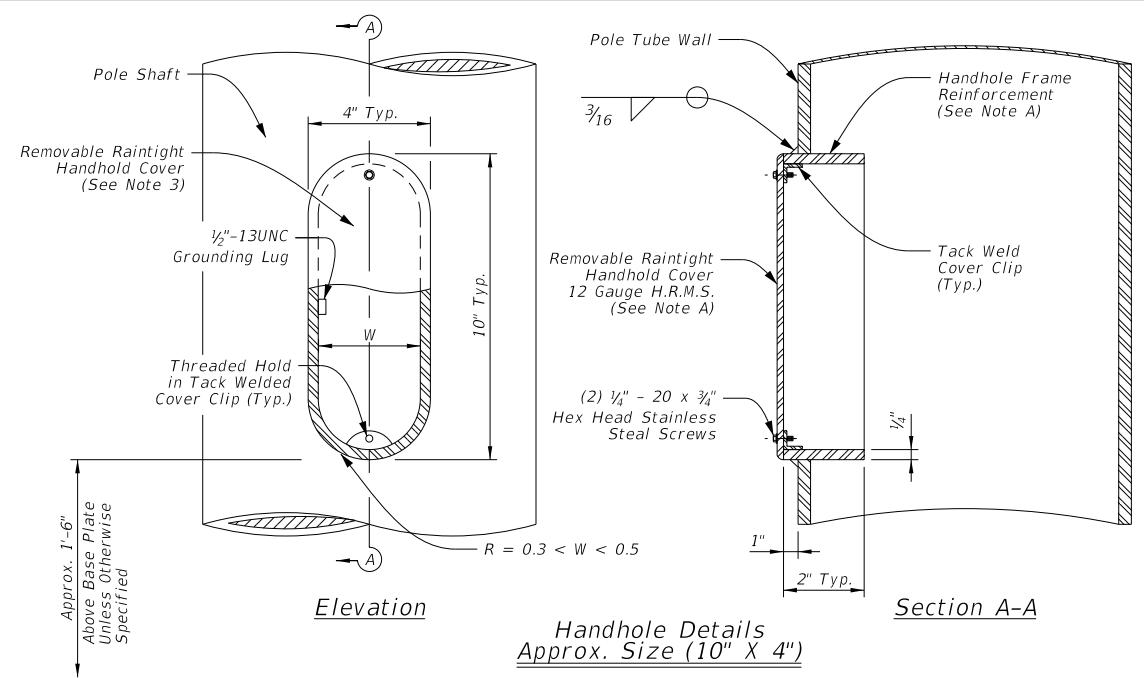

Approved By Bridge Engineer: *SK Li* Date: 9-11-18

Approved By Traffic Engineer: *Cyril* Date: 9/28/18

Traffic Standard
Typical Highway
Light Pole Davit
Mast Arm Details